

# Photometric Report

EXTERIOR WASH PRO XL CTC 4000K – Neutral White


*LM-79-08 Compliant*

## GENERAL SPECIFICATIONS

Total Fixture Output:	17055 lm
Light Engine Output:	23000 lm
Efficacy:	70.5 lm/W
Lens Option:	Native
Beam Angle H (50%):	7°
Beam Angle V (50%):	7°
CRI:	70+
CQS:	74
TM-30 Rf:	75
TM-30 Rg:	99
TLCI:	51
Color Temperature:	4000 K




## SAMPLE MEASUREMENT

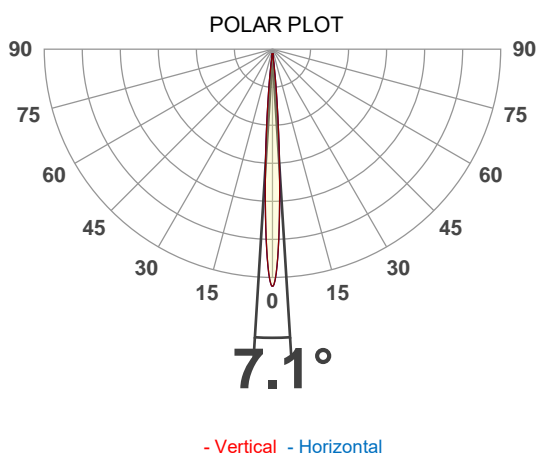

Catalog Number:	MAR-90590012
Measured Output:	17055 lm
Measured Peak:	693425 cd
Consumed Power:	241.9 W
Efficacy:	70.5 lm/W

Beam Angle H (50%):	7.1°
Beam Angle V (50%):	7.1°



Measurement Condition:	
Ambient Temperature:	25° +/- 5° C
AC Supply:	230V/50Hz
Fan Mode:	No Fan
Fixture Warm-up Time:	30 minutes

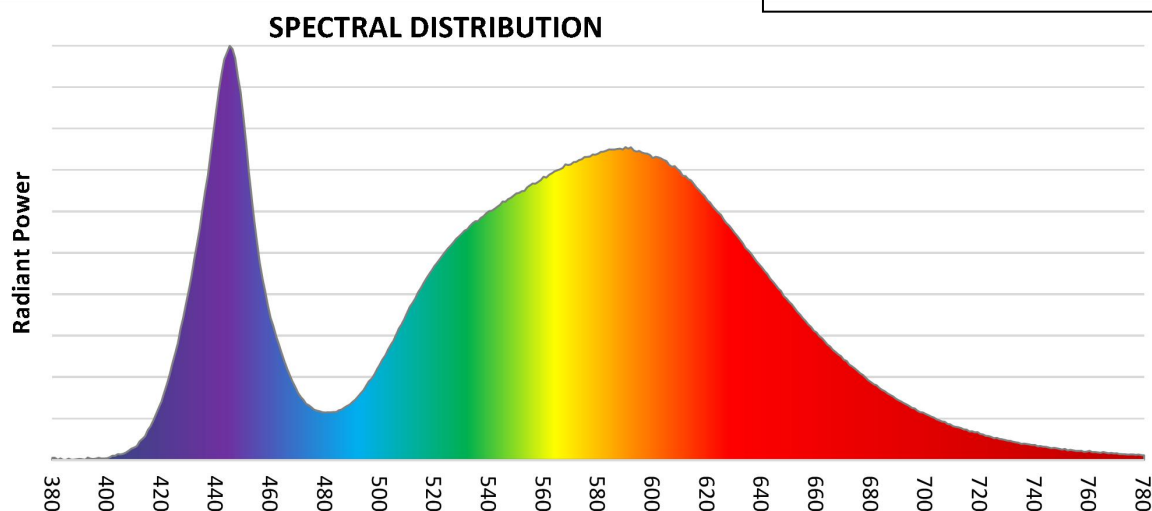


# Photometric Report

EXTERIOR WASH PRO XL CTC 4000K – Neutral White


## CHROMATICITY

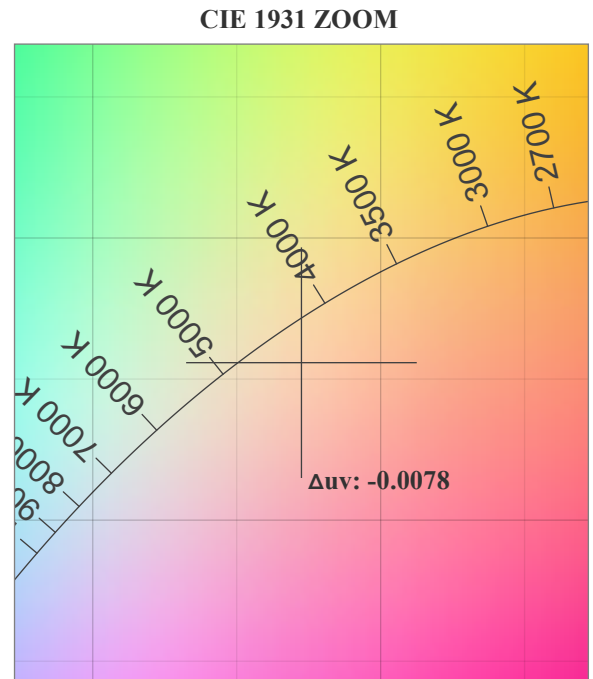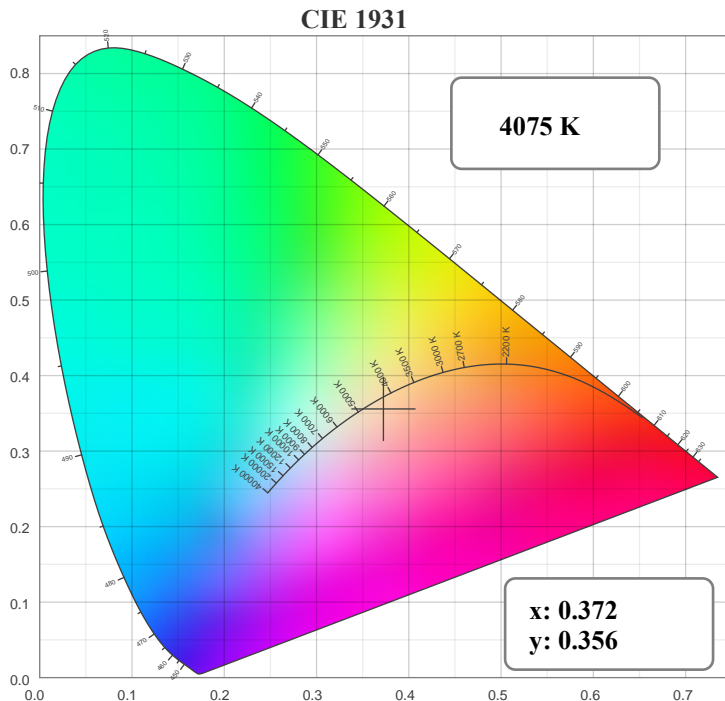

TM30: 75.0

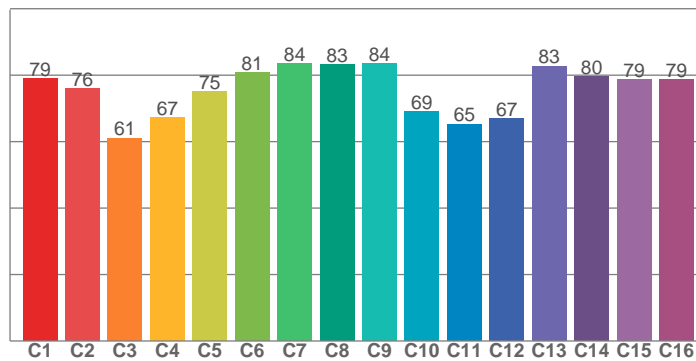


CRI: 77.5 (R1-R8)

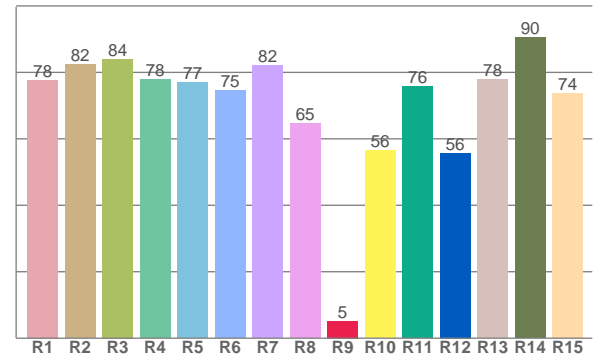

## COLOR PARAMETERS

Color Temperature	Color Rendering Index	Red Component	Color Fidelity	Color Gamut
CCT	CRI	CRI R9	TM30 Rf	TM30 Rg
4075 K	77.5	5.2	75.0	99.7

CQS: 74.2

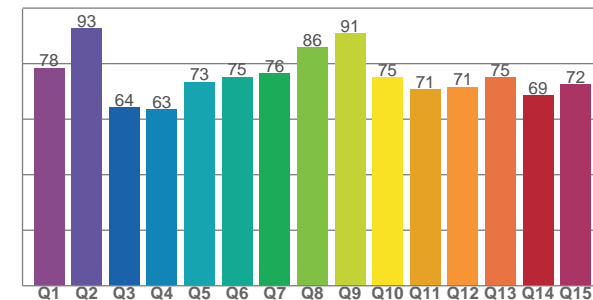

Television Lighting Consistency Index	Color Quality Scale	Color Coordinate CIE 1931	Color Coordinate CIE 1931	Color Coordinate CIE 1964	Color Coordinate CIE 1964	Color Deviation from Black Body
TLCI	CQS	x	y	u	v	Δuv
51	74.2	0.372	0.356	0.228	0.327	-0.0078

# Photometric Report

EXTERIOR WASH PRO XL CTC 4000K – Neutral White

TM30



**Rf 75.0**

Fidelity index Rf



**Rg 99.7**

Gamut index Rg



Hue Bin	R <sub>f</sub>	Graphic shifts (%)	
		Chroma	Hue
1	79	-13%	-3%
2	76	-10%	10%
3	61	-4%	21%
4	67	7%	20%
5	75	14%	12%
6	81	13%	-1%
7	84	3%	-10%
8	83	-5%	-9%
9	84	-11%	-4%
10	69	-14%	12%
11	65	-4%	23%
12	67	6%	19%
13	83	13%	5%
14	80	12%	-1%
15	79	5%	-15%
16	79	-3%	-14%

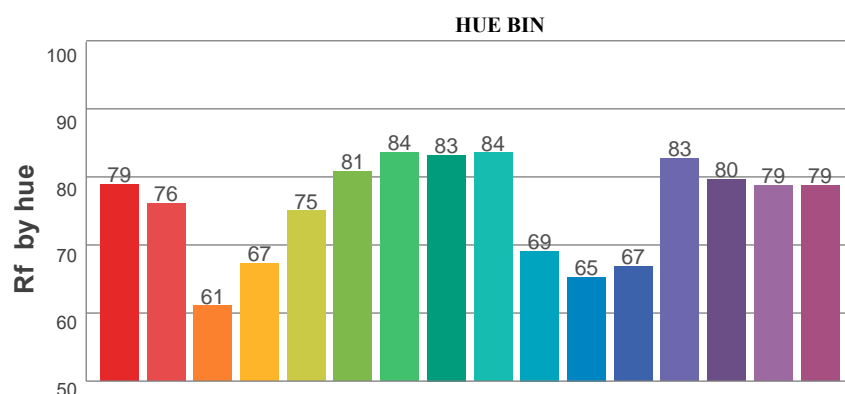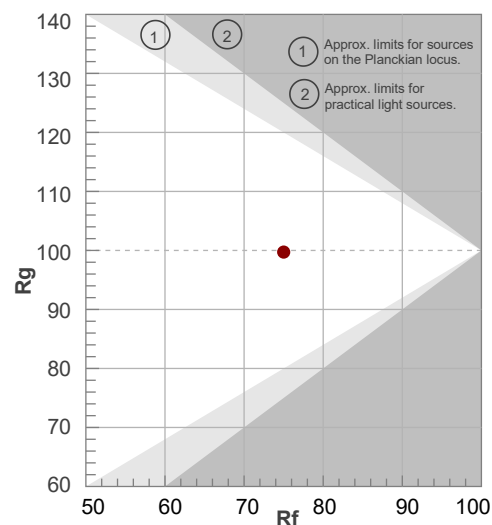

COLOR VECTOR GRAPHICS

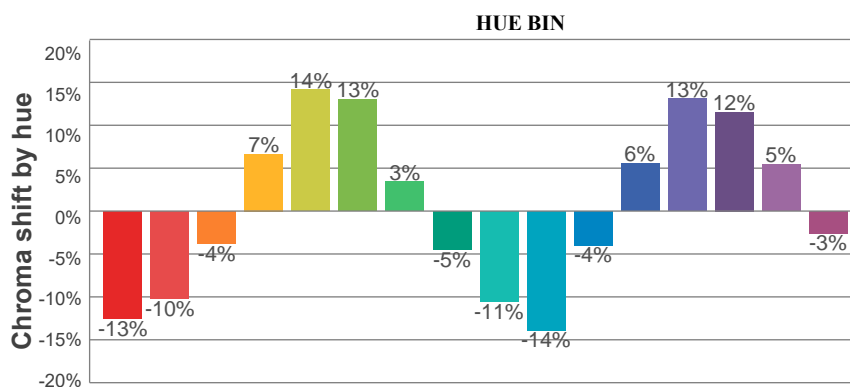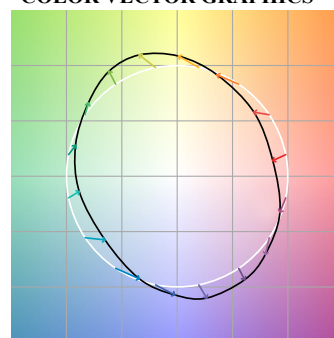


COLOR DISTORTION GRAPHICS

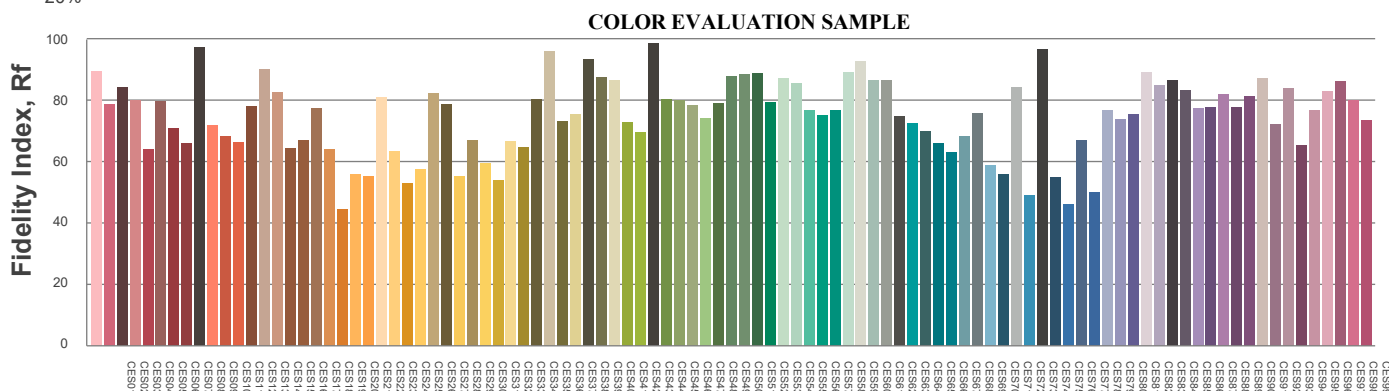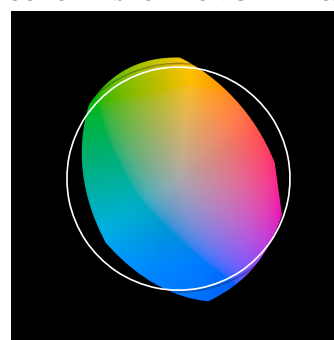

# Photometric Report

EXTERIOR WASH PRO XL CTC 4000K – Neutral White

## BEAM DETAILS

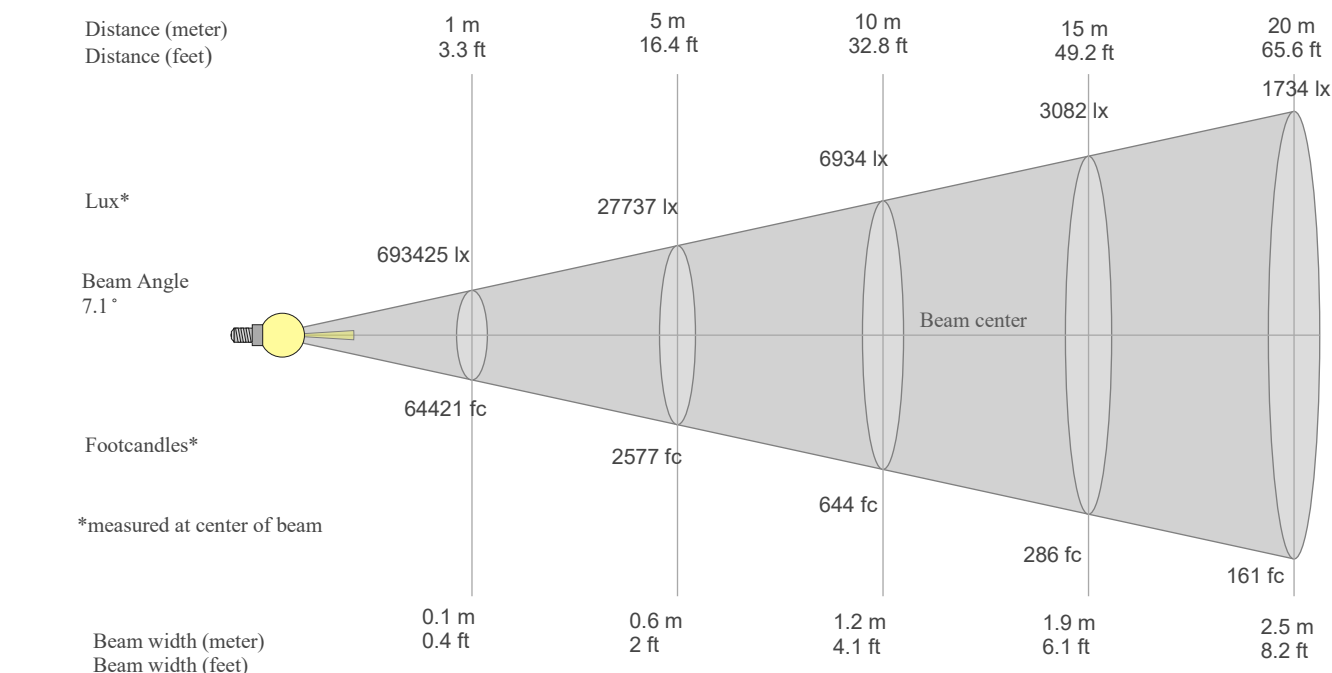


Beam width:  
Illuminance:  $= 0.1 * \text{distance}$   
 $= 693425 / (\text{distance}^2)$

distance in [m] for illuminance in [lux]    distance in [ft] for illuminance in [fc]

## BEAM ILLUMINANCE FROM 1-20M

1m	2m	3m	4m	5m	6m	7m	8m	9m	10m	11m	12m	13m	14m	15m	16m	17m	18m	19m	20m
3.3ft	6.6ft	9.8ft	13.1ft	16.4ft	19.7ft	23ft	26.2ft	29.5ft	32.8ft	36.1ft	39.4ft	42.7ft	45.9ft	49.2ft	52.5ft	55.8ft	59.1ft	62.3ft	65.6ft
693425lx	173356lx	77047lx	43339lx	27737lx	19262lx	14152lx	10835lx	8561lx	6934lx	5731lx	4815lx	4103lx	3538lx	3082lx	2709lx	2399lx	2140lx	1921lx	1734lx
64421.3fc	16105.3fc	7157.9fc	4026.3fc	2576.9fc	1789.5fc	1314.7fc	1006.6fc	795.3fc	644.2fc	532.4fc	447.4fc	381.2fc	328.7fc	286.3fc	251.6fc	222.9fc	198.8fc	178.5fc	161.1fc

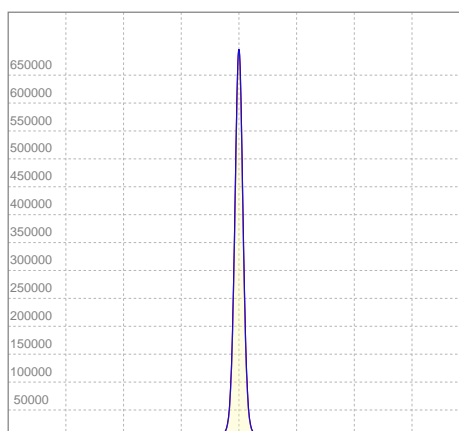

BEAM ANGLE H 50%	BEAM ANGLE V 50%
7.1 °	7.1 °

# Photometric Report

EXTERIOR WASH PRO XL CTC 4000K – Neutral White

## TEST INFORMATION

Test date: From November 13th, 2023, to November 20th, 2023  
Date of receipt samples: November 20th, 2023  
Quantity of receipt samples: 1 unit per model

## EQUIPMENT LIST

ID	Instrument	Model	Cal. date	Next cal. Date
AC Power Meter	EF-I-0287	PF9811	2023.11.08	2023.12.08
AC Power Meter	EF-I-1002	PF2010	2023.11.08	2023.12.08
Photometric colorimetric electric system (2 meter sphere)	EF-I-900	HASS 2000	Before used	Before used
21V/3.9289A standard lamp	EF-I-963	D204	2023.11.08	2023.12.08
Goniophotometer	EF-I-902	GO-R5000	2023.11.08	2023.12.08
Wireless temperature transmitter	EF-I-958	DWRP-B(0)	2023.11.08	2023.12.08

## REFERENCE STANDARDS OR METHODS

ANSI/NEMA/ ANSLG C78.377-2017 Specifications for the Chromaticity of Solid State Lighting Products  
ANSI C82.77-2002 Harmonic Emission Limits Related Power Quality Requirements for Lighting Equipment  
CIE Pub. No. 13.3-1995 Method of Measuring and Specifying Color Rendering of Light Sources  
CIE Pub. No. 15:2004 Colorimetry  
IES LM-79-08 Electrical and Photometric Measurements of Solid-State Lighting Products

# Photometric Report

EXTERIOR WASH PRO XL CTC 4000K – Neutral White

## TEST CONDUCTED AND METHOD

### Ambient Condition

The ambient temperature in which measurements are being taken was maintained at  $25 \pm 2$  °C, the air flow around the sample(s) being tested did not affect the performance.

### Power Supply Characteristics

The AC power supply had a sinusoidal voltage wave shape at the prescribed frequency (60 Hz) such that the RMS summation of the harmonic components does not exceed 3 percent of the fundamental during operation of the test item.

The voltage of AC power supply (RMS voltage) applied to the device under test was regulated to within 0.2 percent under load.

### Seasoning and Stabilization

No seasoning was performed in accordance with IESNA LM-79-08. And before the measurement, the sample was stabilized until the light output and power variations were less than 0.5% in 30 minutes intervals (3 readings, 15 minutes apart).

### Electrical Instrumentation

The calibration uncertainties of the instruments for AC voltage and current were less than 0.2 percent, and the calibration uncertainty of the AC power meter was less than 0.5 percent (9% confidence interval,  $k=2$ ).

### Color Measurement Method

Spectral radiant flux was measured by a sphere (2 meter)-spectroradiometer system, and the color characteristics (Color rendering index, correlated color temperature, chromaticity coordinate) were calculated from these by software automatically.

10 samples were measured as customer required.

### Total Luminous Flux Measurement Method

Total luminous flux was measured by both sphere-spectroradiometer system and goniophotometer.

Spectral radiant flux was measured by a sphere (2 meter)-spectroradiometer system, and the total luminous flux was calculated from these by software automatically.

Light intensity distribution was measured by a type C goniophotometer (with mirror) which can keep the sample in burn position when the tests conduct, and the total luminous flux was calculated from the intensity data by software automatically.

1 sample was measured by sphere method, and 1 sample was measured by goniophotometer method.

Correction factor (self-absorption) has been considered when doing measurement.

### Luminous Intensity Distribution Measurement Method

Light intensity distribution was measured by a type C goniophotometer (with mirror) which can keep the sample in burn position when the tests conduct, and the kinds of graph were generated by software automatically.

1 sample was measured as customer required.